


15 KV  
COOPER

CONNECTOR 1/0 AWG  
COOPER CC6A13U

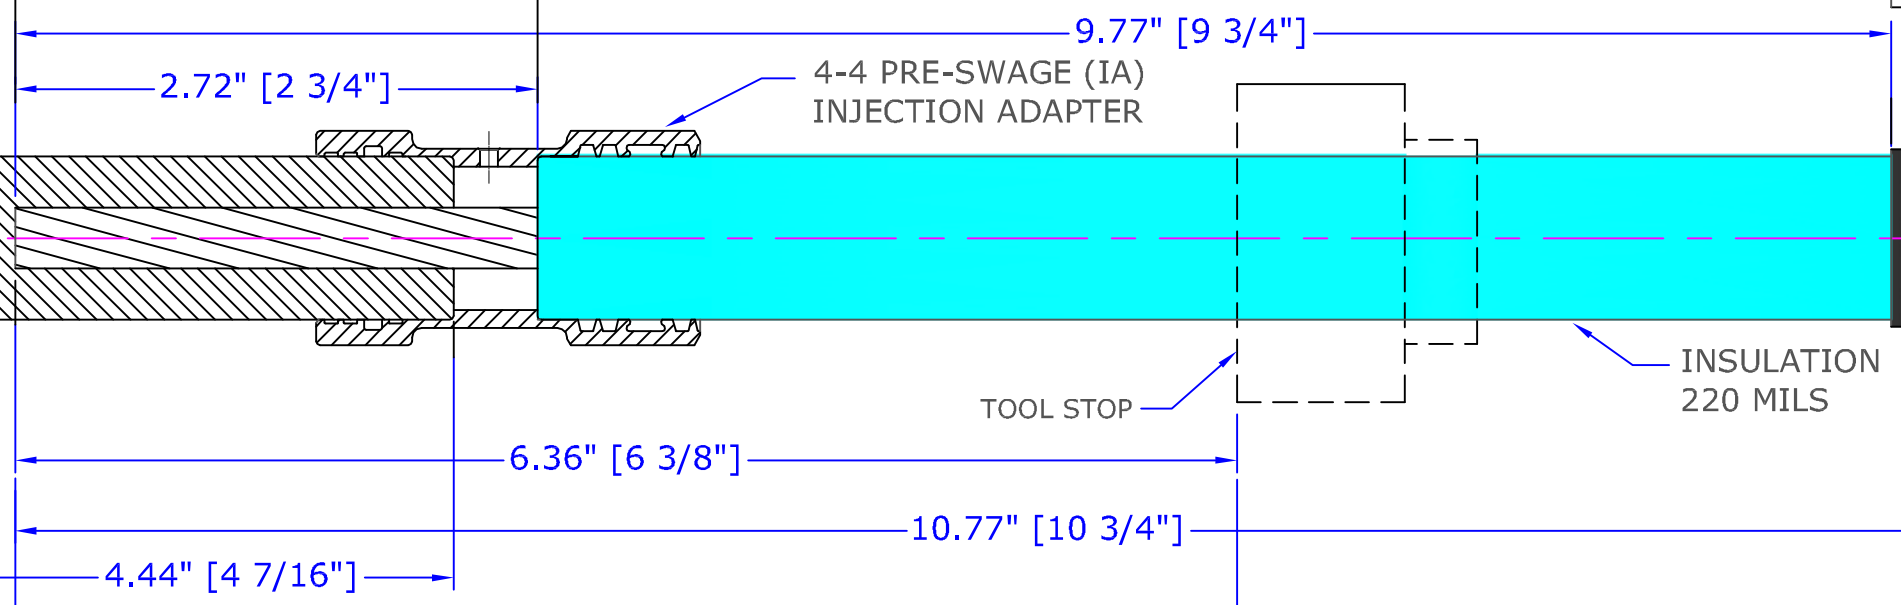

INSULATION CUT  
BACK TEMPLATE

SEMI-CON SHIELD

MARKING TAPE

COOPER® BT625 T-BODY

SEMI-CON SHIELD

CABLE INSULATION  
ADAPTER CA625 C

TOOL STOP CUT  
BACK TEMPLATE

**NOTE: THE INSULATION ADAPTER MUST  
BE ON THE CABLE BEFORE SWAGING THE  
CONNECTOR. SEE NRI 31 & NRI 32**

The marking tape must be located from end of strip cable (as shown as pre-swage) to end of cable insulation adapter and should be within 1/4" inch [6mm] after swage.

CPR-15 BT625C 10 4-4 5mar10

© Copyright 2007, Novinium. All rights reserved.  
IA is protected by patents and patents pending.  
COOPER is a registered trademark of Cooper Power Systems, Inc. novinium is a registered trademark of novinium.  
(Printing instructions: For best results, print in color, protect w/5mil laminate and trim to size.)



SCALE: 1:1

8.5 x 22 paper size